

# Sustainable AI infrastructure: A scenario-based forecast of water footprint under uncertainty

Manuel Herrera

*School of Engineering, Newcastle University, UK*

`manuel.herrera@ncl.ac.uk`

Xiang Xie

*School of Engineering, Newcastle University, UK*

Andrea Menapace

*Free University of Bozen-Bolzano, Italy*

Ariele Zanfei

*AIaqua s.r.l., Italy*

Bruno M. Brentan

*Universidade Federal de Minas Gerais, Brazil*

## **Preprint Statement:**

This is a **non-peer reviewed preprint** submitted to **EarthArXiv**.  
The manuscript has also been submitted for peer review to the journal  
*Cleaner Production*.

# Sustainable AI infrastructure: A scenario-based forecast of water footprint under uncertainty<sup>\*</sup>

Manuel Herrera<sup>a,\*</sup>, Xiang Xie<sup>a</sup>, Andrea Menapace<sup>b</sup>, Ariele Zanfei<sup>c</sup>,  
Bruno M. Brentan<sup>d</sup>

<sup>a</sup>*School of Engineering, Newcastle University, Newcastle upon Tyne, NE1 7RU, United Kingdom*

<sup>b</sup>*School of Engineering, Free University of Bozen-Bolzano, Bolzano, 39100, Italy*

<sup>c</sup>*AIaqua s.r.l., Via Volta 13/A, Bolzano, Italy*

<sup>d</sup>*Dipartimento di Ingegneria Civile e Architettura, Universidade Federal de Minas Gerais, Belo Horizonte, 31270-055, Brazil*

---

## Abstract

The rapid expansion of artificial intelligence (AI) and cloud computing is creating a significant but often overlooked impact on global water resources. This paper presents a global assessment of water consumption in AI-driven data centres, distinguishing between water consumption for operational use at the facility, off-site water consumption related to electricity generation, and embodied water consumption associated with hardware manufacturing and supply chains. To anticipate future demand, a scenario-based probabilistic forecasting framework inspired by Bayesian methods is developed, combining sparse empirical data with expert-informed assumptions and policy-relevant growth trajectories for the years 2030 and 2050. Results suggest that, without mitigation, global water consumption associated with data

---

<sup>\*</sup>Part of the data, visualisation, and code are available on GitHub code and GitHub world map. For open access, the authors have applied a Creative Commons Attribution (CC BY) licence to any Author Accepted Manuscript version arising.

<sup>\*</sup>Corresponding author: manuel.herrera@ncl.ac.uk (Manuel Herrera)

centres could increase more than seven times by mid-century, with cooling-related operational consumption accounting for the majority of demand. Several mitigation pathways are identified, including improvements in cooling efficiency, adoption of alternative technologies, and infrastructure planning that takes into account regional water availability. A sensitivity analysis highlights the strong influence of compute growth and efficiency trends on future outcomes. The findings offer a transparent and adaptable basis for aligning AI infrastructure development with long-term water sustainability goals.

*Keywords:* Artificial intelligence, Water footprint, Probabilistic forecasting, Data centres, Digital sustainability

---

## **1. Introduction**

Artificial intelligence (AI) and cloud computing are reshaping industries, economies, and daily life. By 2030, global AI adoption is projected to reach unprecedented levels. An estimated 70% of companies worldwide will be using AI technologies, becoming up to roughly \$15 trillion in economic output and productivity gains. For instance, China alone anticipates a 26% GDP boost from AI by 2030, while it will be around 14% in North America (PwC, 2018). Discussions about the environmental impact of data centres have mostly focused on electricity use. Data centres currently account for 1–2% of global electricity consumption, and this share is expected to increase significantly as AI models become more complex and widespread (Cows et al., 2023; Sachs, 2024). Their extension in number and use will lead to global electricity consumption potentially exceeding 3,000 TWh annually

by 2030 (Masanet et al., 2020). While the environmental discourse around AI and data centres has predominantly focused on energy consumption and associated carbon emissions (Bose et al., 2021; Kaack et al., 2022), a holistic understanding of their impact necessitates equal attention to their significant and growing water footprint. This paper aims to address this critical gap by focusing on the water dimension. Specifically, our assessment quantifies the consumptive blue water footprint of AI infrastructure, accounting for the freshwater volumes evaporated, embedded in products, or transferred to other catchments and thus rendered unavailable (Hoekstra et al., 2011). Water consumption will consequently increase, both directly for cooling and indirectly through electricity generation, which can have a substantial water footprint depending on the energy mix (Oró et al., 2015). Specifically, fossil fuel-based power generation, such as coal and natural gas, typically consumes between 2–3 litres per kWh of electricity. Nuclear power (often cited for its low-carbon benefits) can also be water-intensive, especially when once-through cooling systems are used (Jin et al., 2019; Lin et al., 2024).

In response to growing energy demands, companies have invested in renewable energy, efficient processors, and improved energy management systems (Khosravi et al., 2024). Yet water consumption has received much less attention overall. Data centres rely heavily on water for cooling, particularly in systems such as evaporative towers and direct liquid cooling. Water usage effectiveness (WUE) measures the amount of on-site cooling water used per kWh of energy consumption, while power usage effectiveness (PUE) reflects the ratio of total energy use to IT energy. Water consumption for operational use includes both on-site cooling water and off-site water used in electricity

generation, whereas water consumption for embodied use (EWU) refers to the consumptive water required to manufacture hardware such as servers, GPUs, and networking components.

Recent studies show that large-scale AI data centres already consume millions of litres of water per day (Hao, 2024; Dgtl Infra, 2024; Mytton, 2021). Many of these centres are located in regions with limited freshwater availability, including parts of Latin America, the southwestern United States, India, and Australia (Li et al., 2025). Siting decisions often prioritise proximity to data demand hubs or latency constraints, which may not always align with local environmental or water conditions. In addition, the physical separation between data centre operations, electricity generation, and hardware manufacturing contributes to a dispersed environmental footprint. Actually, off-site water used in power production and the embodied water associated with globally sourced hardware is often manufactured in water-stressed regions, which further complicate sustainability planning (Bolón-Canedo et al., 2024).

Despite the importance of water in the broader sustainability of AI systems, quantitative projections of future demand remain rare, especially those that distinguish between different components of water use or account for uncertainty. Most existing assessments focus on electricity or treat water consumption within a general, environmental framework (Al Kez et al., 2022; Isler-Kaya and Karaosmanoglu, 2023; Li et al., 2024). However, a growing number of studies have begun to quantify the direct and indirect water footprints of data centre operations, offering initial estimates and highlighting regional vulnerabilities. This is the case of Siddik et al. (2021), who showed

that nearly 2% of electricity use in the United States (US) is directly attributed to data centres operations, representing approximately 0.5% of the US greenhouse gas emissions. Their work further investigated the trade-off of water and energy utilisation, highlighting that a significant portion of servers' direct water footprint originates from water-stressed watersheds. They, along with other studies, show server efficiency and utilisation, electrical grid water consumption, cooling system type, and climate zone as main determinants for water footprint in data centres Lei et al. (2025). Beyond the US, Farfan and Lohrmann (2023) have explored the electricity and water footprint of digital data services in Europe, demonstrating the regional variability of this impact. Similarly, Ayyildiz et al. (2025) incorporated water availability as a critical criterion for data centre site selection, alongside renewable energy integration.

The still limited work on AI and data centres' water footprint constrains the ability of policymakers and infrastructure planners to prepare for the sustainable expansion of AI. This paper introduces a novel scenario-based probabilistic approach for forecasting the water footprint of AI data centres. This methodology uniquely quantifies future demand by separating water consumption into its operational (on-site and off-site) and embodied components, and by explicitly incorporating uncertainty into future trajectories through probabilistic modelling. The analysis considers three distinct scenarios to reflect different technological and policy pathways: a business-as-usual scenario, in which AI compute demand continues to grow rapidly with limited efficiency gains; a moderate intervention scenario, which assumes sustained but slower growth coupled with incremental improvements in infrastructure

efficiency; and a sustainable transformation scenario, where AI expansion is stabilised and aggressive measures are taken to reduce water and energy intensity. These scenarios aim to capture a realistic range of future outcomes based on current technological and policy trends.

Bayesian-inspired models are well suited to this task, as they enable the integration of sparse empirical data, expert judgment, and scenario-based assumptions (Van de Schoot et al., 2021; Bonomi et al., 2016; Leoni et al., 2021). The analysis focuses on global trends in AI infrastructure, with forecasts until 2050. This time horizon aligns with international sustainability goals, including the UN Sustainable Development Goals and global net-zero commitments for 2030 and 2050. The results offer a structured and transparent basis for more informed planning and policy decisions, particularly in regions already experiencing water stress.

The remainder of the paper is structured as follows. Section 2 introduces the main drivers of water consumption in AI data centres, outlining both the scale of the challenge and a framework for quantifying water consumption. Section 3 reviews and compares key cooling technologies in terms of their water footprint. Their impacts vary by regional water availability, as further discussed in Section 4. Section 5 presents a probabilistic scenario-based forecasting methodology for global water consumption until 2050. Sections 6 and 7 conclude the paper with a discussion of results, policy implications, and recommendations for a sustainable digital infrastructure, along with a summary of key findings and directions for future research. A sensitivity analysis to assess the influence of key parameter is added in Appendix Appendix A.

## 2. Drivers of AI data centre water consumption

The ongoing expansion of AI and cloud computing has led to a surge in data centre infrastructure, raising serious concerns about water consumption. AI workloads, in particular, demand far more computational power than traditional applications, which in turn increases the need for intensive cooling and drives up water consumption (Cowls et al., 2023). Data centres have done substantial research on their energy use, but their water footprint has received far less attention. Some projections suggest that data centres could consume around 1.7 billion litres of water per day by 2030 (Bluefield Research, 2023), though this figure may underestimate actual demand given the accelerating deployment of large-scale AI models and the specialised hardware they require. The current section first introduces the scale and significance of the AI water footprint, and then outlines a methodology for quantifying water demand in data centre operations.

### *2.1. AI water footprint: Impact at scale*

The rapid expansion of AI infrastructure, including hyperscale facilities for cloud servers (e.g., operated by Google, Amazon AWS, and Microsoft) and AI data centres dedicated to specialised workloads such as training LLMs or running inference tasks, has intensified concerns over water sustainability. These centres host clusters of high-performance computing infrastructure, such as GPUs and TPUs, which generate substantial heat and require continuous cooling to operate within thermal safety limits. Overall, AI infrastructure relies on computing setups with high power density that concentrate significantly more processing power per unit of space. AI-focused centres fre-



quently exceed 40 kW, with some reaching up to 80 kW for advanced deep learning workloads (Al Kez et al., 2022, 2025), which is significantly higher than standard enterprise centres, typically operating at power densities of 5 to 10 kW.

The elevated power needs of AI data centres amplify thermal loads, making them strongly dependent on cooling systems, many of which consume large volumes of water. This impact becomes clearer when considering real-world examples. Training GPT-3, a large-scale language model (LLM) developed by OpenAI, required around 1,287 MWh of electricity for a single training cycle, an intensive process typically repeated every one to two years to incorporate new data and enhance model performance (De Vries, 2023). Google’s Gemini model, another high-end generative AI system, was estimated to use over 1 million litres of water for a single training cycle, depending on region-specific cooling configurations (Leon, 2024). Between these major retraining events, smaller fine-tuning operations are conducted more frequently, usually on a monthly or quarterly basis, albeit with significantly lower resource demands. When cooled using typical evaporative systems, this single training run could consume close to 700,000–1,000,000 litres of water—equivalent to the daily water use of 5,000–7,000 people (Hao, 2024; Bhaskar and Seth, 2024). Yet, the rapid evolution of AI makes GPT-3 appear almost prehistoric, given the emergence of more powerful and resource-intensive successors like GPT-4 (released in 2023) and potentially GPT-5 in the near future. A major GPT-scale training event could translate into a water footprint between approximately 1.9 and 4.9 million litres (given typical cooling efficiencies ranging from 1.5 to 3.8 litres per kWh). These newer

generations demand exponentially higher computational resources, driving water consumption even further upward.

The previous examples demonstrate how the resource footprint of AI is already significant and growing. The computational requirements of AI models have been following an exponential trend often referred to as the “AI compute scaling law” (Diaz and Madaio, 2024). Since 2012, the amount of compute needed to train state-of-the-art models has doubled every 3–4 months (Turchin, 2019), even before the widespread adoption of LLMs like ChatGPT. In production settings, inference (the deployment of trained models) also adds ongoing water demand due to the sustained computational loads it generates. Although individual inference requests consume far less water than initial training, their cumulative impact is substantial, especially as billions of daily interactions with AI services become the norm. Addressing this growing sustainability challenge will require targeted improvements in computational efficiency, cooling technologies, and water management practices. Figure 1 shows the trajectory of AI infrastructure suggests continued and accelerating growth.

Given the exponential growth described by the “AI compute scaling law”, forecasts indicate that computational requirements for frontier models could increase 10- to 100-fold by 2030 (Amodei and Hernandez, 2018; Hoffmann et al., 2022; Zhang et al., 2023). Without proactive measures, such dramatic increases will magnify the environmental impacts of AI, disproportionately affecting regions already experiencing water scarcity. Therefore, addressing the sustainability of AI-related water consumption will become increasingly critical as computational demands continue to escalate.

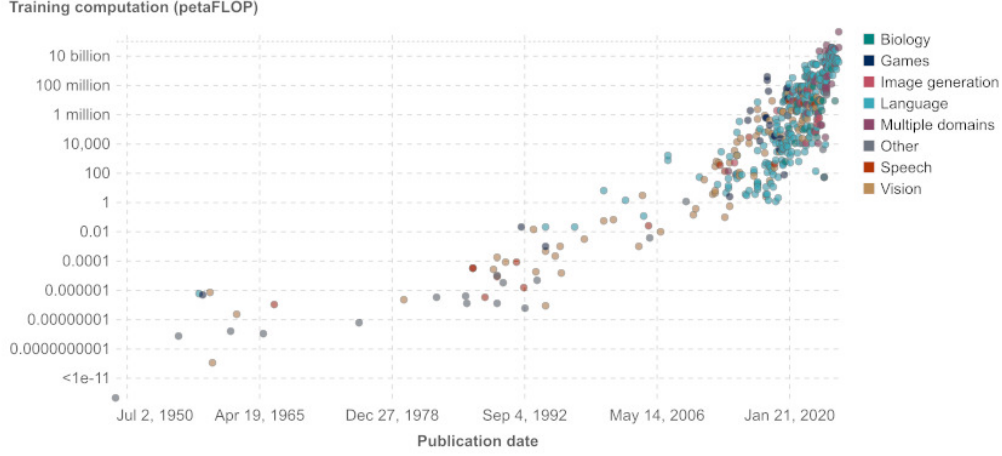


Figure 1: Computation is measured in total petaFLOP, which is  $10^5$  floating-point operations. Estimates are expected to be accurate within a factor of 2, or a factor of 5 for recent undisclosed models like GPT-4. Source: [OurWorldinData.org/artificial-intelligence](https://OurWorldinData.org/artificial-intelligence)

## 2.2. AI water footprint: Quantification

Estimating the water footprint of AI-driven data centres requires breaking it down into its core components. The term 'water footprint' refers to the total volume of freshwater consumed and rendered unavailable for reuse in the production of goods and services. It is conventionally categorised into blue water (surface and groundwater consumed), green water (rainwater stored in soil and used by plants), and grey water (the volume required to assimilate pollutants to meet water quality standards) (Hoekstra et al., 2011). This paper focuses exclusively on the blue water footprint, defined as the volume of freshwater that is evaporated, incorporated into products, or transferred to other catchments; thus becoming unavailable for reuse within the originating basin (Ansorge and Stejskalová, 2025). Green and grey components are excluded from the scope.

The proposed framework follows and extends the structure proposed by Li et al. (2025), quantifying the blue water footprint through three components: (1) on-site operational water consumption (mainly for cooling), (2) off-site water consumption associated with electricity generation, and (3) embodied water consumption linked to hardware manufacturing and supply chains. Equation (1) formalises this decomposition and enables transparent assessment of direct and indirect freshwater demands associated with AI infrastructure,

$$W_{\text{tot}}(t) = W_o(t) + W_x(t) + W_e(t), \quad (1)$$

where the total water consumption,  $W_{\text{tot}}(t)$ , comes defined in terms of all possible data centre water all consumptive water components attributable to data centre operations at time  $t$ :

- $W_o(t)$ : on-site operational water volume used directly for cooling server hardware,
- $W_x(t)$ : off-site water volume consumed in electricity generation required to power the data centre,
- $W_e(t)$ : water embedded in the manufacturing of data centre hardware.

The on-site component is calculated using the water usage effectiveness (WUE), which measures, through Equation (2), volume of cooling water used per unit of IT energy consumed,

$$W_o(t) = e(t) \cdot \rho_o(t), \quad (2)$$

where  $e(t)$  is server energy consumption (kWh/day) at time  $t$ , and  $\rho_o(t)$  is the WUE in litres per kWh. WUE varies with cooling technology, facility design, and ambient climate, and tends to be higher in AI-focused centres due to their denser compute configurations.

The off-site component captures the water associated with electricity production. This is estimated using power usage effectiveness (PUE) and the electricity water intensity factor (EWIF), as per Equation (3),

$$W_x(t) = e(t) \cdot \theta(t) \cdot \rho_x(t), \quad (3)$$

where  $\theta(t)$  is the PUE, defined as the ratio of total energy input to energy used for computing, and  $\rho_x(t)$  is the average water consumption per kWh for electricity generation. EWIF depends heavily on the regional energy mix. Fossil fuel-based electricity typically requires around 2–3 litres per kWh, nuclear generation can have similar or higher water demands depending on cooling technology, while solar and wind are almost water-free (Jin et al., 2019; Lin et al., 2024).

Finally, Equation (4) represents the embodied water. That is the water required to manufacture IT hardware and infrastructure. This is treated as a fixed quantity amortised over the equipment’s lifespan,

$$W_e(t) = \frac{T \cdot W}{T_0}, \quad (4)$$

where  $W$  is the total volume of consumptive water used in production,  $T_0$  is the expected lifespan (in years), and  $T$  is the duration of analysis. Though smaller in daily volume, this component grows with rapid hardware turnover and increasing demand for high-performance AI processors.

Estimates suggest that producing a single AI accelerator GPU can require between 20,000 and 30,000 litres of water, with AI data centres deploying thousands of such units each year (Davenport et al., 2024). The embodied water footprint is becoming increasingly important as hardware demand grows, refresh cycles shorten, and model complexity increases.

### **3. Cooling systems and their role in operational water consumption**

The growing computational demands of AI have intensified thermal loads in data centres, placing increasing pressure on cooling systems and their associated water consumption. While advances in energy efficiency have helped stabilise electricity consumption despite rising service demand (International Energy Agency, 2020; Masanet et al., 2020), maintaining this balance has relied heavily on improvements in cooling infrastructure. This is particularly relevant for AI workloads, which depend on high-performance hardware such as graphics processing units (GPUs) and tensor processing units (TPUs), generating considerably more heat than conventional CPUs (Li et al., 2025).

Cooling demand is further exacerbated by the extended duration of AI training cycles, which can last weeks or even months. Traditional air-based systems are increasingly unable to keep up with these loads, prompting a shift toward more advanced solutions such as liquid and immersion cooling. Liquid cooling offers greater thermal efficiency but often relies on water-based coolants, contributing to total operational water consumption. Immersion cooling, which submerges servers in dielectric fluids, can substantially reduce on-site operational water volume consumed; however, its adoption remains limited due to technical and infrastructural constraints (Jones, 2018; Gao

and Evans, 2021).

The following subsections examine the main cooling systems currently used in AI data centres (air-based, evaporative, and liquid-based approaches), focusing on their water consumption profiles.

### 3.1. Air-based cooling systems

Air cooling is a widely used method that relies on ventilation systems to dissipate heat from servers. Cool air is circulated through server racks, absorbs heat, and is expelled either directly into the environment or through heat exchangers. Figure 2 illustrates a conventional air cooling setup.

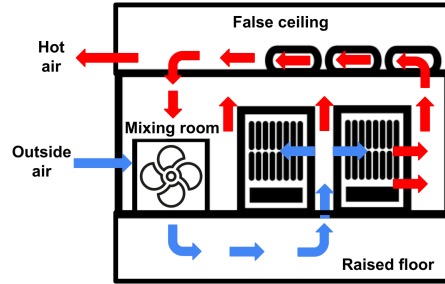


Figure 2: Schematic of a traditional air cooling system used in data centres.

Air cooling has the advantage of minimal direct water consumption, making it preferable in regions where water scarcity is a concern. However, this method typically requires higher energy input, particularly in warmer climates where mechanical cooling systems must supplement ventilation. Studies suggest that air cooling can increase total data centre energy demand by 10–30% compared to evaporative cooling, depending on ambient temperature and humidity levels (Li et al., 2025).

### 3.2. Evaporative cooling towers

Evaporative cooling towers are commonly used in large-scale data centres, particularly in regions where water is relatively abundant, due to their high thermal efficiency (Kim et al., 2014; Chu and Huang, 2023). These systems function by circulating heated water through a cooling tower, where it is sprayed onto fill material to maximise surface area. As air passes through the tower, a portion of the water evaporates, carrying away heat. Figure 3 illustrates the evaporative cooling process.

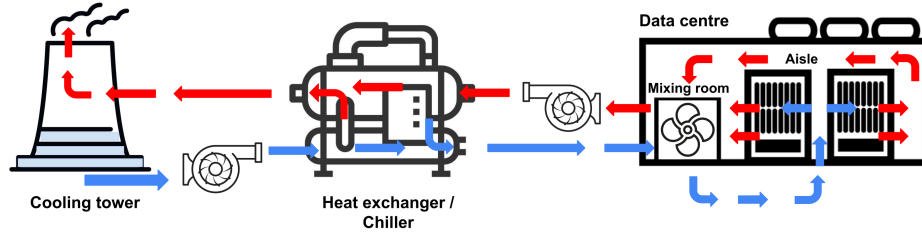


Figure 3: Schematic of a typical data centre evaporative cooling system.

While effective at heat dissipation, evaporative cooling is highly water-intensive. A significant volume of water is lost through evaporation, with additional losses from blowdown, which involves discharging water to remove accumulated minerals and contaminants (Wang et al., 2024). These evaporative and blowdown losses constitute consumptive water volumes that are permanently removed from the local water cycle. The framework proposed in this paper quantifies these volumetric losses but does not account for the grey water footprint associated with pollution assimilation. Given the scale of these losses, particularly in hot and arid climates, evaporative cooling systems can consume millions of litres annually, intensifying sustainability concerns in water-stressed regions (Ristic et al., 2015).



### 3.3. Liquid and immersion cooling

Liquid cooling is gaining traction as a more sustainable alternative, offering high thermal efficiency while reducing water reliance. Two primary techniques are in use:

- *Direct liquid cooling:* A coolant is circulated through cold plates attached to key hardware components such as CPUs and GPUs, drawing heat away efficiently.
- *Immersion cooling:* Servers are fully submerged in dielectric fluid, which absorbs heat and is then cycled through a cooling loop for heat rejection.

Figure 4 shows a schematic of a direct liquid cooling system. In this configuration, liquid coolant is circulated through cold plates that are directly attached to high-heat components such as CPUs and GPUs. The coolant absorbs heat at the source and transports it to a heat exchanger, where the thermal energy is dissipated before the fluid is recirculated. This method provides highly efficient heat removal with minimal thermal resistance, allowing for greater cooling performance in high-density computing environments while significantly reducing reliance on water-intensive evaporative systems.

Liquid cooling significantly reduces water demand, especially in systems where closed-loop coolants replace evaporative methods. It also enables data centres to support higher power densities while reducing cooling energy consumption by up to 50% compared to air-based systems (Google, 2021). However, broader adoption remains limited due to infrastructure costs, integra-

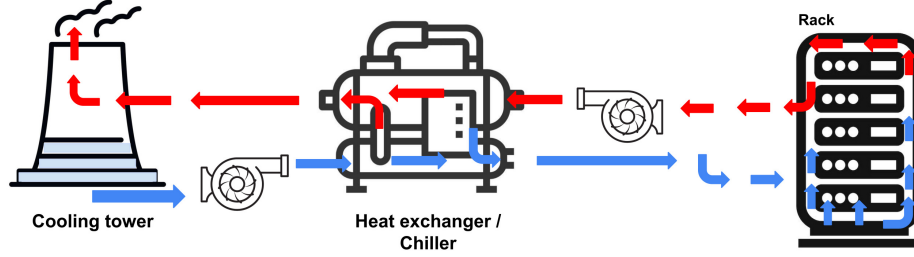


Figure 4: Schematic of a direct liquid cooling solution.

tion complexity, and hardware compatibility requirements. Immersion cooling, in particular, demands significant retrofitting and specialised equipment.

#### 3.4. Adoption rate of cooling technologies

Table 1 compares the three main cooling technologies discussed in this section based on qualitative water consumption, energy efficiency, and adoption level.

Table 1: Comparison of cooling technologies in AI data centres.

Cooling Method	Water volume	Energy efficiency	Adoption level
Air-Based	Low	Moderate–Low	High
Evaporative	High	High	High
Direct Liquid Cooling	Low	Very High	Emerging
Immersion Cooling	Very Low	Very High	Limited

As AI workloads continue to scale, selecting appropriate cooling strategies will be essential for ensuring the long-term sustainability of data centre operations, particularly those that minimise water demand.

Recent market reports show that air-based cooling systems remain dominant, with computer room air conditioners and air handlers accounting for a significant share and growing 64% in the US market between 2020 and 2023 (Research, 2024). However, the shift toward AI and high-density computing is driving increased adoption of advanced cooling methods. The global liquid cooling market is projected to grow from \$5.65 billion in 2024 to over \$48 billion by 2034 (GlobeNewswire, 2025). Immersion cooling, in particular, is gaining traction in North America, which held more than 35% of the global market share in 2023 (Global Market Insights Inc., 2023). These trends indicate a growing transition toward more water- and energy-efficient thermal management strategies.

#### **4. Regional variations in data centre water consumption**

Water consumption in AI data centres is not uniform across the globe. Facility clusters tend to emerge in regions with strong digital infrastructure, tax incentives, and access to renewable energy. However, many of these locations coincide with areas already experiencing water stress, exacerbating competition between data centres, agriculture, and residential use. This geographic mismatch raises environmental and social concerns, particularly where water-intensive cooling technologies are deployed without adequate regulation or local consultation. Moreover, regional disparities in data availability and transparency can complicate assessments of water consumption and hinder long-term planning.

Figure 5 illustrates the global distribution of major data centres as of 2025, overlaid with national water stress levels. Data centre deployment re-

mains heavily concentrated in regions such as North America, Europe, India, and parts of Oceania. These locations reflect established digital infrastructure hubs, though not always aligned with regional water sustainability. Data centres number by country were compiled from Data Center Map (2025), while World Resources Institute (2024) provides water stress classifications.

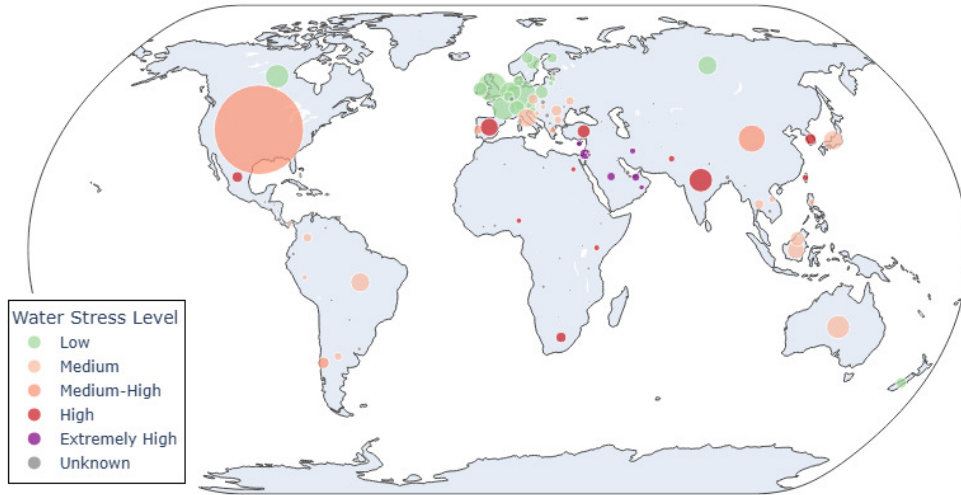


Figure 5: Global distribution of data centres and national water stress levels. The size of the bubble is proportional to the number of data centres, while the colour relates to water stress: from green (low) to purple (extremely high). Interactive HTML version and underlying data are available on [GitHub code](#) and [GitHub world map](#).

Figure 5 shows how the United States hosts by far the largest number of data centres, yet many of these are situated in regions classified as having medium-high water stress. India, a rising digital powerhouse, also shows substantial growth in data centre infrastructure despite facing high water stress across much of the country. In Europe, Spain stands out as a nation with high water stress yet a significant number of facilities, in contrast to nearby countries like Germany or the United Kingdom, where water stress

is generally lower. A number of local but representative examples of the growing tension between AI-driven computational expansion and increasingly strained water resources is enumerated in the following bullet points:

- In the United Kingdom, Thames Water has raised concerns over the impact of data centre water consumption, warning that restrictions may be imposed during heatwaves (Zuo et al., 2015; BBC News, 2025).
- In the southwestern United States, major tech companies in Arizona and Virginia consume millions of litres of water daily, leading to mounting public scrutiny and regulatory discussions on sustainable cooling practices (Mytton, 2021). Some operators have begun exploring the use of recycled water and liquid cooling to reduce dependency on potable sources.
- In China, data centres water consumption is expected to exceed three billion cubic meters annually by 2030. Most facilities are concentrated in the country’s northern provinces, many of which already experience chronic water scarcity. In response, national policy initiatives are encouraging a shift toward less water-intensive cooling solutions (e.g., direct liquid and air-based cooling) and greater adoption of renewable energy (He et al., 2019).
- Latin America has also seen a rapid rise in data centre construction, often in areas lacking the infrastructure to support industrial-scale water consumption. In countries like Chile and Brazil, this has sparked debate over the long-term viability of data centre evolution under worsening drought conditions (Farfan and Lohrmann, 2023).

These regional disparities emphasise the need for context-specific water management strategies that account for local hydrological conditions, infrastructure constraints, and regulatory frameworks. They also highlight the importance of anticipating regional vulnerability when projecting future demand.

The Köppen climate classification offers an additional perspective for evaluating regional suitability. It categorises global regions based on long-term temperature and precipitation patterns (Beck et al., 2018), providing an eco-climatic lens often linked to vegetation cover and water resource availability (Sohoulande, 2024). Arid climates, such as BWh (hot desert) and BSh (hot semi-arid), include regions like the southwestern United States, northern Mexico, Australia, and northern Africa. These areas are poorly suited for water-intensive cooling systems like evaporative towers, as their high temperatures, low humidity, and limited freshwater availability exacerbate evaporative losses and strain local water resources. Temperate climates, in contrast, including Cfb (temperate oceanic) and Cfa (humid subtropical), offer more favourable conditions for air-based or hybrid cooling systems thanks to lower ambient temperatures and higher humidity levels. Incorporating Köppen-based climate criteria into siting assessments can help align infrastructure development with regional water sustainability, particularly as climate variability and digital infrastructure demand increase globally.

Cooling systems are not the only factor influencing water consumption. Policy, operational practices, and infrastructure design also affect overall consumption. The next section presents forecast scenarios for 2030 and 2050, using a probabilistic framework to examine potential outcomes under differ-

ent trajectories of growth and efficiency.

## **5. Forecast scenarios for 2030 and 2050: A probabilistic scenario-based approach**

Accurately estimating the future water footprint of AI-driven data centres is challenging due to the lack of high-resolution global data and the rapid pace of technological change. Traditional forecasting methods, which rely heavily on historical trends, are poorly suited to emerging infrastructures such as large-scale AI deployments, where future demand is shaped not by past behaviour, but by evolving models, hardware, and operational strategies.

This paper adopts a probabilistic scenario-based forecasting framework to address the above challenges. This semi-quantitative approach is particularly appropriate in data-scarce contexts, as it allows uncertainty to be handled transparently by combining sparse empirical observations with expert-informed assumptions. It models three key components of water consumption: on-site operational, off-site operational (linked to electricity generation), and embodied water (linked to hardware manufacturing and supply chain). Ultimately, the proposal generates probabilistic estimates rather than single-point predictions.

Scenario-based forecasting is used to explore a range of plausible futures in the absence of reliable trend data. The three scenarios used are business-as-usual, moderate intervention, and sustainable transformation. They represent different trajectories of compute evolution and efficiency improvements. The probabilistic approach enables a more robust and flexible assessment of long-term water consumption under uncertainty, providing useful guidance

for infrastructure planning and environmental governance.

### 5.1. Probabilistic scenario-based forecasting

The forecasting approach uses Monte Carlo simulation to propagate uncertainty in model parameters and compute global water consumption under different future scenarios. Although it does not implement full Bayesian inference, it incorporates prior assumptions about input variables and generates probabilistic estimates of future outcomes. This setup allows us to explore a range of plausible trajectories given current knowledge, scenario-specific assumptions, and anticipated efficiency improvements.

The forecast years 2030 and 2050 are particularly interesting as they align with international environmental targets, including the UN Sustainable Development Goals and the European Union’s Green Deal horizon. The prior distributions for model inputs are defined based on current conditions, including server electricity consumption in the base year 2025, denoted as  $e(2025)$ . This is modelled as a Normal distribution, as shown in Equation (5), using industry estimates for AI infrastructure (Masanet et al., 2020).

$$e(2025) \sim \mathcal{N}(\mu = 1.0 \times 10^9, \sigma = 0.1 \times 10^9) \quad (\text{kWh/day}). \quad (5)$$

Parameters for water-related efficiency: WUE, PUE and EWIF, that is  $\rho_1(t)$ ,  $\theta(t)$ , and  $\rho_2(t)$ , respectively; are treated as deterministic values that improve incrementally each year. Based on recent technical reports and industry trends (International Energy Agency, 2020; Google, 2021), annual efficiency improvements in the range of 0.5–1% are assumed. These rates reflect modest but realistic gains from gradual adoption of more efficient cooling technologies, infrastructure optimisation, and cleaner energy sources. In



practice, such improvements could also reflect emerging technologies that reduce net energy demand either directly, through more efficient cooling methods such as immersion or direct-to-chip liquid cooling, or indirectly, through waste heat reuse. While the latter does not reduce cooling energy demand itself, it contributes to lowering net primary energy use at a broader system level. Both approaches decrease energy demand in different ways and, as a consequence, can also indirectly reduce water consumption. Regarding the embodied water use (EWU) is similarly assumed to improve at a fixed annual rate, denoted  $\text{EWU}^*$ , as manufacturing processes and supply chains become more efficient.

Computational expansion rates are scenario-dependent, considering three representative cases:

- *Business-as-usual* (BAU): AI use continues to grow rapidly, with compute demand increasing by 10% per year.
- *Moderate intervention*: Growth slows due to policy and efficiency measures, with compute demand rising by 5% per year.
- *Sustainable transformation*: No further growth in compute demand; AI infrastructure stabilises at current levels.

These scenarios represent plausible upper, middle, and lower bounds of future AI adoption, based on historical data and expert forecasts (Amodei and Hernandez, 2018; Zhang et al., 2023; Hoffmann et al., 2022). This three-tier scenario structure is inspired by frameworks commonly used in climate policy modelling, especially those assessing greenhouse gas trajectories. The BAU case corresponds to a continuation of current trends without significant

mitigation, analogous to baseline emissions scenarios. The moderate intervention scenario aligns with intermediate mitigation pathways, where policy and technological improvements yield gradual reductions in impact. The sustainable transformation case mirrors net-zero policy ambitions, involving aggressive shifts in infrastructure, energy efficiency, and environmental stewardship. Drawing this parallel underscores the importance of water governance in AI infrastructure, similar to that of carbon management in climate action. Comparable scenario structures have been widely adopted in climate modelling literature, such as the Shared Socioeconomic Pathways (SSPs) developed by the Intergovernmental Panel on Climate Change (IPCC) (Riahi et al., 2017).

Using the defined scenario-specific growth rates, baseline energy consumption, and incremental improvements in efficiency parameters (WUE, PUE, EWIF, and EWU), the process constructs likelihood functions based on plausible developments in computational demand, cooling performance, and hardware turnover.

Monte Carlo simulation is applied with 10,000 iterations to generate probabilistic estimates of future water demand across the defined scenarios. In each iteration, random samples are drawn from the prior distributions, and total water demand is computed using Equation (1). This process makes it possible to trace how uncertainty in the inputs, such as future energy use or efficiency gains, shapes the range of possible outcomes (Zhang, 2021). Monte Carlo methods are particularly well-suited to contexts where uncertainty is high and model variables interact in complex ways. Rather than producing a single forecast, the simulation yields a range of plausible outcomes, helping

to assess how different assumptions influence projected water consumption. For each forecast year and scenario, this results in an empirical distribution of daily water demand values that captures the variability in the underlying inputs.

Let  $\{w_t^{(1)}, w_t^{(2)}, \dots, w_t^{(N)}\}$  be the set of  $N = 10,000$  model outputs computed using Equation (1) for year  $t$ . The 90% credible interval is constructed as the central interval containing 90% of the distribution mass, as shown in Equation (6),

$$\text{CI}_{90\%}(W_t) = [q_{0.05}, q_{0.95}], \quad (6)$$

where  $q_{0.05}$  and  $q_{0.95}$  are the 5th and 95th percentiles of the sorted simulated values, respectively. These quantiles are computed non-parametrically, without assuming any specific distribution shape. The resulting 90% credible interval reflects the range within which the true value of  $W_t$  lies with 90% probability, conditional on the data and prior-informed assumptions (Gelman et al., 2015).

Algorithm 1 summarises the full computational workflow used to generate the scenario-based forecasts. It outlines the sampling of prior distributions, the forward projection of efficiency parameters, and the iterative computation of total water demand across all scenarios and years, including the construction of simulated means and credible intervals. Note that in, Algorithm 1, superscript asterisks (\*) denote annual improvement rates for each efficiency parameter. The framework could be adapted to include spatial disaggregation using location-specific efficiency parameters, subject to data availability. We considered this extension out of the current scope and is

discussed as future research in Section 7.

---

**Algorithm 1** Monte Carlo simulation algorithm for scenario-based forecasting of annual water consumption (2025–2050) in AI data centres

---

```

1: Input: Prior distribution for server energy use  $e_{2025} \sim \mathcal{N}(\mu, \sigma)$ 
2:      Initial values for WUE  $\rho_1(2025)$ , PUE  $\theta(2025)$ , EWIF  $\rho_2(2025)$ 
3:      Annual improvement rates: WUE*, PUE*, EWIF*, EWU*
4:      Initial embodied water use  $W_{\text{emb}}(2025)$  and equipment lifespan  $T_0$ 
5:      Scenario-specific compute growth rate  $g$ 
6: Output: Simulated distribution of  $W_T(t)$  for each year  $t = 2025$  to 2050

7: for each scenario in {BAU, Moderate, Sustainable} do
8:   for each year  $t$  from 2025 to 2050 do
9:      $y \leftarrow t - 2025$  ▷ Years since base year
10:    Sample  $N$  values of  $e^{(i)}(2025) \sim \mathcal{N}(\mu, \sigma)$ 
11:    Compute  $e^{(i)}(t) = e^{(i)}(2025) \cdot (1 + g)^y$ 
12:    Update parameters:
13:       $\rho_1(t) = \rho_1(2025) \cdot (1 - \text{WUE}^*)^y$ 
14:       $\theta(t) = \theta(2025) \cdot (1 - \text{PUE}^*)^y$ 
15:       $\rho_2(t) = \rho_2(2025) \cdot (1 - \text{EWIF}^*)^y$ 
16:       $W_{\text{emb}}(t) = W_{\text{emb}}(2025) \cdot (1 - \text{EWU}^*)^y / T_0$ 
17:    for each  $i = 1$  to  $N$  do
18:       $W_{\text{on}}^{(i)}(t) = e^{(i)}(t) \cdot \rho_1(t)$ 
19:       $W_{\text{off}}^{(i)}(t) = e^{(i)}(t) \cdot \theta(t) \cdot \rho_2(t)$ 
20:       $W_T^{(i)}(t) = (W_{\text{on}}^{(i)}(t) + W_{\text{off}}^{(i)}(t)) / 10^9 + W_{\text{emb}}(t) / 10^9$ 
21:    end for
22:    Store simulated mean and credible interval of  $W_T(t)$ 
23:  end for
24: end for

```

---

To maintain the relevance of the forecasts as technological and operational data evolve, the framework is designed to support scheduled reassessment. This would involve updating model inputs (e.g., WUE, PUE, EWIF) annually or biannually as new empirical evidence becomes available, and re-running the scenario simulations accordingly. Such a dynamic approach would enable more accurate tracking of water-related sustainability in AI infrastructure, helping to refine policy and investment decisions over time.

### *5.2. Probabilistic scenario projections from scenario-based simulations*

The scenario simulations provide a probabilistic view of global water consumption for AI data centres under the three defined scenarios. Table 2 summarises the results, reporting the mean estimates and 90% credible intervals for the years 2030 and 2050.

Table 2: Probabilistic scenario projections of global data centre water consumption (billion litres/day).

Scenario	2030	2050
Business-as-usual (BAU)	4.18 [3.67–4.68]	28.11 [24.71–31.47]
Moderate intervention	3.06 [2.68–3.44]	8.36 [7.31–9.72]
Sustainable transformation	1.86 [1.63–2.09]	1.38 [1.15–1.61]

These projections highlight the influence of both computational use and efficiency gains. Under the BAU scenario, global water demand is projected to increase nearly sevenfold between 2030 and 2050. In contrast, moderate intervention results in a more manageable trajectory, while the sustainable transformation scenario leads to a net reduction in water use by mid-century.

The results align with recent concerns raised in studies on the environmental impact of AI infrastructure. For example, Hao (2024) estimate that global water consumption by data centres could exceed 20 billion litres/day by 2050 under baseline assumptions—closely matching the trajectory of BAU scenario. However, the framework presented here adds a probabilistic interpretation that accounts explicitly for uncertainty and expert-informed variability. Figure 6 visualises the simulated means and 90% credible intervals for each scenario.

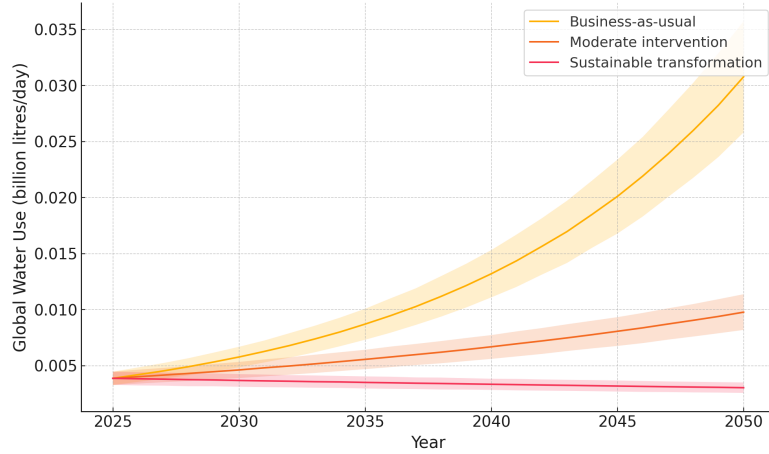


Figure 6: Simulated mean estimates and 90% credible intervals for data centre water consumption under each scenario.

These results reflect the importance of policy and design interventions. Under a BAU trajectory, exponential increasing trend in water use could intensify water stress in already vulnerable regions. Moderate growth coupled with efficiency improvements yields significant reductions, while the sustainable transformation scenario suggests that systemic changes, such as transitioning to non-water-based cooling and extending hardware lifespans,

can decouple AI adoption from rising water consumption.

Achieving the sustainable scenario will require a combination of regulatory measures, technological innovation, and forward-looking infrastructure planning.

## 6. Discussion and recommendations

This section examines the implications of projected water consumption from AI data centres. The analysis shows that cooling systems are the primary driver of water use, and without targeted intervention, global consumption could rise sharply by mid-century. A scenario-based probabilistic framework was used to identify key leverage points for mitigation and to support planning under uncertainty. The discussion is organised around interpretation of the results, evaluation of the modelling approach, and policy and design recommendations for reducing the water footprint of AI infrastructure.

### *6.1. Interpreting the scenarios: Trade-offs and leverage points*

The analysis shows that global water consumption by AI data centres could rise dramatically by 2050, particularly under a BAU trajectory driven by increasing model complexity and compute demand. However, the results also show that this trend is not inevitable. If the industry adopts more efficient cooling systems and moderates infrastructure expansion, water demand could be substantially reduced, even under moderate compute growth.

The sensitivity analysis of Appendix A confirms that operational water use dominates total consumption and is most responsive to improvements in water usage effectiveness (WUE) and power usage effectiveness (PUE).



Embodied water use (EWU) contributes a smaller share but remains relevant, particularly as hardware refresh cycles shorten.

These findings suggest that water sustainability cannot be achieved through energy decarbonisation alone. A wider view is needed to integrate water, energy, and emissions into the design and operation of AI infrastructure.

### *6.2. Probabilistic scenario-based framework: Strengths and limitations*

The scenario-based approach used in this study is well-suited to situations where data is scarce or changing rapidly. It combines expert judgement with scenario-based assumptions to handle uncertainty in a transparent way. This makes it particularly useful for forecasting the environmental impacts of fast-moving technologies like AI.

A key strength of the probabilistic scenario-based approach is its ability to produce credible forecasts without relying on comprehensive historical datasets, a common limitation in the context of private digital infrastructure. Many companies do not publicly disclose detailed water usage statistics due to commercial sensitivities or cybersecurity concerns, making it difficult to build traditional models. This reinforces the value of probabilistic forecasting tools that are robust to data scarcity while still supporting policy making.

Nevertheless, the framework has limitations. Although model variables interact through deterministic equations, their probabilistic inputs are treated independently — that is, no statistical dependencies or correlations are modelled between them. This simplification may overlook important interrelationships, especially under scenarios involving simultaneous technological or policy changes. In reality, technological disruption and regional feedback loops may introduce nonlinear effects that future models should seek to cap-

ture. Incorporating real-time monitoring data and adapting the model into a dynamic Bayesian framework are promising directions for improving accuracy.

### *6.3. Interpretation of results and policy implications*

The scenarios presented here have clear implications for water governance in the AI age. Without targeted interventions, global water consumption could increase by nearly sevenfold by 2050, driven by computational trending use and the power density of AI workloads. While energy-related emissions have received considerable attention, water consumption remains a largely underappreciated consequence of AI scaling. The scenario design also reflects a conceptual parallel to climate mitigation pathways, suggesting that water-related impacts of AI infrastructure may benefit from policy tools, scenario planning, and regulatory foresight similar to those used in carbon emissions governance.

Water-related tensions surrounding data centre operations are emerging in many regions, particularly where infrastructure expansion overlaps with existing water stress. These conflicts are likely to intensify as extreme weather events become more frequent and climate variability increases. Several utilities and regulators have already signalled the possibility of restricting water access for data centres during periods of drought or peak demand (BBC News, 2025). Such developments reinforce the point that strategies centred solely on energy decarbonisation are insufficient. Water sustainability must be treated as a core pillar of responsible AI infrastructure planning.

At the same time, it is important to recognise that certain AI applications actively contribute to environmental sustainability. Models developed

for smart grid management, building optimisation, climate forecasting, and ecosystem monitoring offer tangible benefits for energy and water efficiency. These workloads can support mitigation and adaptation goals across multiple sectors. Encouraging such environmentally focused AI, while managing the resource intensity of large-scale generative models, could help align digital innovation with broader climate and sustainability agendas.

Achieving reductions in water use will require adoption of water-efficient cooling technologies (e.g., liquid and immersion cooling), shifts to renewable and low-water energy sources, and regulations that account for EWU in hardware procurement and life cycle assessments. International standards for sustainability reporting and site location planning could also help prevent water stress clustering across borders. Current frameworks such as the EU’s Green Deal and state-level regulations in the US (e.g., California’s Water Conservation Act) offer promising models for implementation (Commission, 2020; California Department of Water Resources, 2023).

Technological developments, such as AI-based energy optimisation and modular data centre design, could further reduce both operational and embodied water consumption. Based on the paper findings, it is recommended a multi-pronged strategy to support sustainable AI infrastructure:

- Accelerate deployment of low-water and closed-loop cooling technologies, including direct liquid and immersion systems (Microsoft, 2020; Google, 2021).
- Incorporate grey-water and non-potable sources for data centre cooling, especially in regions facing municipal water stress (Farfan and Lohrmann, 2023).

- Promote real-time cooling optimisation through AI-driven management systems.
- Require disclosure of water use metrics (e.g., WUE, EWIF, EWU) in sustainability reporting frameworks (United Nations, 2019).
- Integrate water availability into data centre siting decisions to avoid clustering in already-stressed regions.

Additionally, emerging strategies such as the reuse of waste heat from computing operations (for example, aiming to provide residential or district heating) may offer indirect reductions in both energy and water consumption. Although not explicitly modelled, such innovations represent promising directions in practice and should be evaluated alongside direct cooling and siting improvements.

While this paper focuses on probabilistic forecasting of the blue water footprint, the results also highlight emerging geographic mismatches between AI infrastructure growth and regional water availability. Many rapidly expanding data centre clusters are located in water-stressed regions, driven primarily by economic factors such as low electricity prices, often linked to a high share of renewables or tax incentives, and land availability, rather than by hydrological suitability. To address this mismatch, water stress and climate indicators should be integrated into data centre siting decisions. The proposed framework, though global in scope, is adaptable to regionalised assessments, allowing future work to incorporate location-specific parameters such as climate classification, WUE benchmarks, and local energy-water interactions. Embedding such refinements can support infrastructure planning

that explicitly aligns digital growth with water sustainability, avoiding future conflicts over scarce freshwater resources.

## 7. Conclusions

This paper introduces a novel scenario-based probabilistic framework for forecasting the global water footprint of AI-driven data centres, representing a significant advancement in understanding and projecting the environmental impacts of AI infrastructure. It offers a structured quantification of on-site, off-site, and embodied water use, and applies a probabilistic simulation approach to generate forecasts until 2050 under varying assumptions of technological growth and efficiency. The approach provides a flexible tool for strategic planning, particularly in data-sparse environments, and identifies which technical factors have the most leverage for reducing long-term consumption (i.e., cooling efficiency, compute growth). This information can support infrastructure design, sustainability reporting, and policy development.

The findings suggest that, if current trends continue unchecked, global data centre water consumption could increase more than sevenfold by mid-century. However, this trajectory is not inevitable. Improvements in cooling performance, the adoption of alternative water sources, and better alignment between siting decisions and regional climate conditions could substantially curb demand. While the current model operates at a global scale, incorporating geospatial variation represents a valuable extension. A regionally disaggregated version could express water consumption as a summation over all regions, each with location-specific parameters for WUE, EWIF, and em-

bodied water intensity. This would better capture the uneven distribution of infrastructure and environmental pressure, offering stronger guidance for climate-aligned siting decisions and water governance.

Future work should develop regionalised models that reflect country-level differences in climate, infrastructure, electricity mix, and regulatory conditions. Indexing water use by region or country would allow for integration of data centre density, cooling technology adoption, and local water stress. Dynamic Bayesian models could also be explored to incorporate real-time data as it becomes available. Finally, integrating water, energy, and emissions into a unified sustainability metric would provide a more comprehensive assessment of AI’s environmental impact.

The growth of AI does not have to come at the expense of water resources. With the right technologies, policies, and foresight, digital expansion and environmental responsibility can advance together. Strategic improvements in cooling systems (WUE), electricity sourcing (EWIF), and hardware lifecycle management (EWU) could reduce 2050 water use by up to 95% relative to business-as-usual scenarios. Realising this potential will require coordinated action from industry, regulators, and researchers to:

- Accelerate the deployment of immersion and closed-loop cooling technologies;
- Develop standardised frameworks for water accounting across operational and embodied domains;
- Enforce climate-aware siting policies that reflect regional water constraints;

- Fund research, development, and demonstration (RD&D) of water-efficient AI hardware and systems.

Improved transparency from technology providers, especially around real-time water use, will also support more accurate forecasting and help guide long-term planning for sustainable infrastructure.

## References

- Al Kez, D., Foley, A., Wong, F.W., BM, H., Dolfi, A., Srinivasan, G., 2025. AI-driven cooling technologies for high-performance data centers: State-of-the-art review and future directions. Social Science Research Network doi:10.2139/ssrn.5148380.
- Al Kez, D., Foley, A.M., Laverty, D., Del Rio, D.F., Sovacool, B., 2022. Exploring the sustainability challenges facing digitalization and internet data centers. Journal of Cleaner Production 371, 133633. doi:10.1016/j.jclepro.2022.133633.
- Amodei, D., Hernandez, D., 2018. AI and compute. OpenAI Blog URL: <https://openai.com/research/ai-and-compute>. accessed March 2025.
- Ansorge, L., Stejskalová, L., 2025. Water footprint which is not the water footprint: Critical review of the article by müller et al. (2024). Journal of Environmental Management 374, 124038. doi:10.1016/j.jenvman.2025.124038.
- Ayyildiz, E., Yildirim, B., Aydin, N., 2025. Location selection methodology for data center with renewable energy integration. Renewable Energy , 123270doi:10.1016/j.renene.2025.123270.

- BBC News, 2025. Concern UK’s AI ambitions could lead to water shortages.  
URL: <https://www.bbc.co.uk/news/articles/ce85wx9jjndo>.
- Beck, H.E., Zimmermann, N.E., McVicar, T.R., Vergopolan, N., Berg, A., Wood, E.F., 2018. Present and future köppen-geiger climate classification maps at 1-km resolution. *Scientific Data* 5, 1–12. doi:10.1038/sdata.2018.214.
- Bhaskar, P., Seth, N., 2024. Environment and sustainability development: A chatgpt perspective, in: *Applied Data Science and Smart Systems*. CRC Press, pp. 54–62. doi:10.1201/9781003471059.
- Bluefield Research, 2023. Data Center Water Usage Projections. Technical Report. Bluefield Research. URL: <https://www.bluefieldresearch.com>.
- Bolón-Canedo, V., Morán-Fernández, L., Cancela, B., Alonso-Betanzos, A., 2024. A review of green artificial intelligence: Towards a more sustainable future. *Neurocomputing* , 128096doi:10.1016/j.neucom.2024.128096.
- Bonomi, M., Camilloni, C., Cavalli, A., Vendruscolo, M., 2016. Metainference: A bayesian inference method for heterogeneous systems. *Science Advances* 2, e1501177. doi:10.1126/sciadv.1501177.
- Bose, R., Roy, S., Mondal, H., Chowdhury, D.R., Chakraborty, S., 2021. Energy-efficient approach to lower the carbon emissions of data centers. *Computing* 103, 1703–1721. doi:10.1007/s00607-020-00889-4.
- California Department of Water Resources, 2023. Making Water Conservation a California Way of Life: Implementing Ex-



- Executive Order B-37-16. Technical Report. State of California. URL: <https://water.ca.gov/Programs/Water-Use-And-Efficiency/Making-Conservation-a-California-Way-of-Life>. accessed March 17, 2025.
- Chu, J., Huang, X., 2023. Research status and development trends of evaporative cooling air-conditioning technology in data centers. *Energy and Built Environment* 4, 86–110. doi:10.1016/j.enbenv.2021.08.004.
- Commission, E., 2020. The European Green Deal. Technical Report COM(2019) 640 final. European Commission. URL: [https://ec.europa.eu/info/strategy/priorities-2019-2024/european-green-deal\\_en](https://ec.europa.eu/info/strategy/priorities-2019-2024/european-green-deal_en). accessed March 17, 2025.
- Cowls, J., Tsamados, A., Taddeo, M., Floridi, L., 2023. The AI gambit: leveraging artificial intelligence to combat climate change—opportunities, challenges, and recommendations. *Ai & Society* , 1–25doi:10.1007/s00146-021-01294-x.
- Data Center Map, 2025. Data center map - global database of data centers. <https://www.datacentermap.com>. Accessed: 2025-04-08.
- Davenport, C., Singer, C., Mehta, N., et al., 2024. Generational growth: AI, data centers and the coming us power demand surge. Goldman Sachs Research Report 26. URL: <https://www.goldmansachs.com/insights/goldman-sachs-research/generational-growth-ai-data-centers-and-the-coming-us-power-demand-surge>.

- De Vries, A., 2023. The growing energy footprint of artificial intelligence. *Joule* 7, 2191–2194. doi:10.1016/j.joule.2023.09.004.
- Dgtl Infra, 2024. Data center water usage. URL: [dgtlinfra.com/data-center-water-usage/](https://dgtlinfra.com/data-center-water-usage/). accessed: 2025-03-07.
- Diaz, F., Madaio, M., 2024. Scaling laws do not scale, in: Proceedings of the AAAI/ACM Conference on AI, Ethics, and Society, pp. 341–357. doi:10.1609/aies.v7i1.31641.
- Farfan, J., Lohrmann, A., 2023. Gone with the clouds: Estimating the electricity and water footprint of digital data services in europe. *Energy Conversion and Management* 290, 117225. doi:10.1016/j.enconman.2023.117225.
- Gao, J., Evans, D., 2021. Google data center cooling: Machine learning application and sustainability outcomes. Google Sustainability Reports URL: <https://sustainability.google/projects/machine-learning/>. accessed March 2025.
- Gelman, A., Carlin, J.B., Stern, H.S., Dunson, D.B., Vehtari, A., Rubin, D.B., 2015. Bayesian Data Analysis. 3rd ed., CRC Press, Boca Raton, FL.
- Global Market Insights Inc., 2023. Data center immersion cooling market size, industry share and forecast, 2023–2032. <https://www.gminsights.com/industry-analysis/...> Available at: <https://www.gminsights.com/industry-analysis/...>

- GlobeNewswire, 2025. Data center liquid cooling market size to hit usd 10 billion by 2030. <https://www.globenewswire.com/news-release/2025/...>. Available at: <https://www.globenewswire.com/news-release/2025/...>
- Google, 2021. Google to Replenish 120% of the Water It Uses by 2030. Technical Report. Google Press Release. URL: <https://www.blog.google>.
- Hao, K., 2024. Ai is taking water from the desert. The Atlantic URL: <https://www.theatlantic.com>.
- He, G., Zhao, Y., Jiang, S., Zhu, Y., Li, H., Wang, L., 2019. Impact of virtual water transfer among electric sub-grids on china's water sustainable developments in 2016, 2030, and 2050. Journal of Cleaner Production 239, 118056. doi:10.1016/j.jclepro.2019.118056.
- Hoekstra, A.Y., Chapagain, A.K., Aldaya, M.M., Mekonnen, M.M., 2011. The Water Footprint Assessment Manual: Setting the Global Standard. Earthscan, London and Washington, D.C.
- Hoffmann, J., Borgeaud, S., Mensch, A., Buchatskaya, E., Hennigan, T., Cassirer, J., Jones, T., et al., 2022. Training compute-optimal large language models. ArXiv preprint arXiv:2203.15556 URL: <https://arxiv.org/abs/2203.15556>.
- International Energy Agency, 2020. Data Centres and Data Transmission Networks. Technical Report. IEA. URL: <https://www.iea.org/reports/data-centres-and-data-transmission-networks>. accessed March 2025.

- Isler-Kaya, A., Karaosmanoglu, F., 2023. Life cycle assessment of a climate-friendly data center cooling device. *Energy and Buildings* 288, 113006. doi:10.1016/j.enbuild.2023.113006.
- Jin, Y., Behrens, P., Tukker, A., Scherer, L., 2019. Water use of electricity technologies: A global meta-analysis. *Renewable and Sustainable Energy Reviews* 115, 109391. doi:10.1016/j.rser.2019.109391.
- Jones, N., 2018. How to stop data centres from gobbling up the world’s electricity. *Nature*. doi:10.1038/d41586-018-06610-y.
- Kaack, L.H., Donti, P.L., Strubell, E., Kamiya, G., Creutzig, F., Rolnick, D., 2022. Aligning artificial intelligence with climate change mitigation. *Nature Climate Change* 12, 518–527. doi:10.1038/s41558-022-01377-7.
- Khosravi, A., Sandoval, O.R., Taslimi, M.S., Sahrakorpi, T., Amorim, G., Pabon, J.J.G., 2024. Review of energy efficiency and technological advancements in data center power systems. *Energy and Buildings* , 114834doi:10.1016/j.enbuild.2024.114834.
- Kim, M.H., Ham, S.W., Park, J.S., Jeong, J.W., 2014. Impact of integrated hot water cooling and desiccant-assisted evaporative cooling systems on energy savings in a data center. *Energy* 78, 384–396. doi:10.1016/j.energy.2014.10.023.
- Lei, N., Lu, J., Shehabi, A., Masanet, E., 2025. The water use of data center workloads: A review and assessment of key determinants. *Resources, Conservation and Recycling* 219, 108310. doi:10.1016/j.resconrec.2025.108310.

- Leon, M., 2024. The escalating AI's energy demands and the imperative need for sustainable solutions. *WSEAS Transactions on Systems* 23, 444–457. doi:10.37394/23202.2024.23.46.
- Leoni, L., Cantini, A., BahooToroody, F., Khalaj, S., De Carlo, F., Abaei, M.M., BahooToroody, A., 2021. Reliability estimation under scarcity of data: a comparison of three approaches. *Mathematical Problems in Engineering* 2021, 5592325. doi:10.1155/2021/5592325.
- Li, P., Yang, J., Islam, M.A., Ren, S., 2025. Making ai less' thirsty': Uncovers and addressing the secret water footprint of AI models. *Communications of the ACM* , 54–61doi:10.1145/3724499.
- Li, P., Yang, J., Wierman, A., Ren, S., 2024. Towards environmentally equitable AI via geographical load balancing, in: *Proceedings of the 15th ACM International Conference on Future and Sustainable Energy Systems*, pp. 291–307. doi:10.1145/3632775.3661938.
- Lin, H., Zhang, S., Cao, R., Yu, S., Bai, W., Zhang, R., Yang, J., Dai, L., Chen, J., Zhang, Y., et al., 2024. A review on the risk, prevention and control of cooling water intake blockage in coastal nuclear power plants. *Nuclear Engineering and Technology* 56, 389–401. doi:10.1016/j.net.2023.10.009.
- Masanet, E., Shehabi, A., Lei, N., Smith, S., Koomey, J., 2020. Recalibrating global data center energy-use estimates. *Science* 367, 984–986. doi:10.1126/science.aba3758.

- Microsoft, 2020. Microsoft Will Replenish More Water Than It Consumes by 2030. Technical Report. Microsoft Blog. URL: <https://blogs.microsoft.com>.
- Mytton, D., 2021. Data centre water consumption. *npj Clean Water* 4, 11. doi:10.1038/s41545-021-00101-w.
- Oró, E., Depoorter, V., Garcia, A., Salom, J., 2015. Energy efficiency and renewable energy integration in data centres. strategies and modelling review. *Renewable and Sustainable Energy Reviews* 42, 429–445. doi:10.1016/j.rser.2014.10.035.
- PwC, 2018. Sizing the Prize: What’s the Real Value of AI for Your Business and How Can You Capitalise? Technical Report. PricewaterhouseCoopers. URL: <https://www.pwc.com/gx/en/issues/data-and-analytics/publications/artificial-intelligence-study.html>. accessed: 2025-04-07.
- Research, A., 2024. Us data center market analysis 2024: Current trends and future prospects. URL: <https://www.arizton.com/market-reports/us-data-centers>. accessed: 2025-04-08.
- Riahi, K., Van Vuuren, D.P., Kriegler, E., Edmonds, J., O’neill, B.C., Fujimori, S., Bauer, N., Calvin, K., Dellink, R., Fricko, O., et al., 2017. The shared socioeconomic pathways and their energy, land use, and greenhouse gas emissions implications: An overview. *Global environmental change* 42, 153–168. doi:10.1016/j.gloenvcha.2016.05.009.

- Ristic, B., Madani, K., Makuch, Z., 2015. The water footprint of data centers. *Sustainability* 7, 11260–11284. doi:10.3390/su70811260.
- Sachs, G., 2024. AI is poised to drive 160% increase in data center power demand. Goldman Sachs Insights 14. URL: [goldmansachs.com/insights/articles/AI-poised-to-drive-160-increase-in-power-demand](https://goldmansachs.com/insights/articles/AI-poised-to-drive-160-increase-in-power-demand).
- Van de Schoot, R., Depaoli, S., King, R., Kramer, B., Märtens, K., Tadesse, M.G., Vannucci, M., Gelman, A., Veen, D., Willemsen, J., et al., 2021. Bayesian statistics and modelling. *Nature Reviews Methods Primers* 1, 1. doi:10.1038/s43586-020-00001-2.
- Siddik, M.A.B., Shehabi, A., Marston, L., 2021. The environmental footprint of data centers in the United States. *Environmental Research Letters* 16, 064017. doi:10.1088/1748-9326/abfba1.
- Sohoulande, C.D., 2024. Vegetation and water resource variability within the köppen-geiger global climate classification scheme: a probabilistic interpretation. *Theoretical and Applied Climatology* 155, 1081–1092. doi:10.1007/s00704-023-04682-z.
- Turchin, A., 2019. Assessing the future plausibility of catastrophically dangerous ai. *Futures* 107, 45–58. doi:10.1016/j.futures.2018.11.007.
- United Nations, 2019. World Water Development Report. UNESCO. URL: <https://www.unesco.org>.
- Wang, W., Li, L., Gao, M., Zhang, M., Xu, Q., Wang, J., 2024. Water-saving performance study of water conservation and plume abatement device in

wet mechanical draft cooling towers. *Case Studies in Thermal Engineering* 56, 104188. doi:10.1016/j.csite.2024.104188.

World Resources Institute, 2024. Aqueduct water risk atlas. <https://www.wri.org/applications/aqueduct/country-rankings>. Accessed April 2025.

Zhang, J., 2021. Modern monte carlo methods for efficient uncertainty quantification and propagation: A survey. *Wiley Interdisciplinary Reviews: Computational Statistics* 13, e1539. doi:10.1002/wics.1539.

Zhang, N., Saxena, S., Sharma, T., Zhang, T., Brynjolfsson, E., et al., 2023. The AI index 2023 annual report. URL: <https://aiindex.stanford.edu/report/>. accessed March 2025.

Zuo, J., Pullen, S., Palmer, J., Bennetts, H., Chileshe, N., Ma, T., 2015. Impacts of heat waves and corresponding measures: a review. *Journal of Cleaner Production* 92, 1–12. doi:10.1016/j.jclepro.2014.12.078.

## **Appendix A. Sensitivity analysis**

A sensitivity analysis was conducted how changes in key efficiency parameters affect long-term water projections, a relative sensitivity analysis was conducted for the year 2050. The analysis evaluates the impact of  $\pm 20\%$  changes in input parameters (WUE, PUE, EWIF, and EWU) on total projected water consumption under the BAU scenario.

Figure A.7 presents the results as a tornado plot, showing the relative change in 2050 water use compared to the baseline. WUE has the highest



influence on water consumption, followed closely by EWIF and PUE, which together govern the operational water footprint. EWU shows a smaller, but still relevant, impact, consistent with its amortised contribution to daily water use.

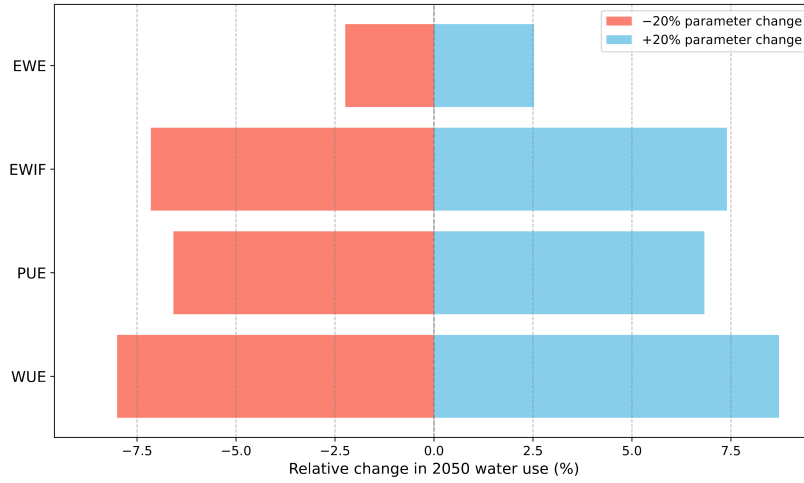


Figure A.7: Sensitivity of 2050 water use forecasts to  $\pm 20\%$  changes in key input parameters, relative to BAU baseline.

Table A.3 shows how these relative differences translate into absolute changes in projected water consumption. Under the BAU baseline of 28.11 billion litres/day, a 20% improvement in WUE corresponds to a reduction of 4.69 billion litres/day, while a deterioration increases water use by a similar amount. Comparable absolute effects are observed for EWIF and PUE, with differences of 4.24 and 4.02 billion litres/day, respectively. EWU contributes a smaller difference of 1.29 billion litres/day, reflecting the lower sensitivity of the embodied component.

This analysis highlights that improvements in cooling and power infrastructure have the greatest potential for reducing long-term water consump-

Table A.3: Absolute differences (billion litres/day) in projected 2050 water consumption under  $\pm 20\%$  parameter shifts. BAU baseline = 28.11 billion litres/day

Parameter	Relative diff. (%)	Abs. diff
WUE	16.7%	4.69
PUE	14.3%	4.02
EWIF	15.1%	4.24
EWU	4.6%	1.29

tion. Nonetheless, advances in hardware design and procurement practices also play a role and should not be overlooked in water sustainability strategies.